


NOTES:

1. GEOTECHNICAL REPORT PREPARED BY LICENSED ENGINEER IS REQUIRED TO DETERMINE LIME OR CEMENT APPLICATION RATE.
2. SUBGRADE COMPACTION SHALL BE 95% STANDARD PROCTOR DENSITY.
3. LIME SHALL BE APPLIED AT 6% BY WEIGHT. MINIMUM QUANTITY IS 36LBS/SY. IN SOME AREAS A GREATER QUANTITY (OR A LIME SERIES TEST) MAY BE REQUIRED AT THE CITY'S DISCRETION
4. CONCRETE SHALL BE APPLIED AT 4% BY WEIGHT, MINIMUM QUANTITY IS 28LBS/SY.
5. CONCRETE STRENGTH SHALL BE MINIMUM 3600 PSI FOR MACHINE POUR & 4000 PSI FOR HAND POUR

* NEW RESIDENTIAL STREETS
WITHIN CLEBURNE CITY LIMITS



DETAIL NAME / PROJECT NO. TYPICAL STREET SECTION – NEW RESIDENTIAL		
ENGINEERING SERVICES DEPARTMENT	FILE:	SCALE: NOT TO SCALE
		DATE: 2020 VERSION

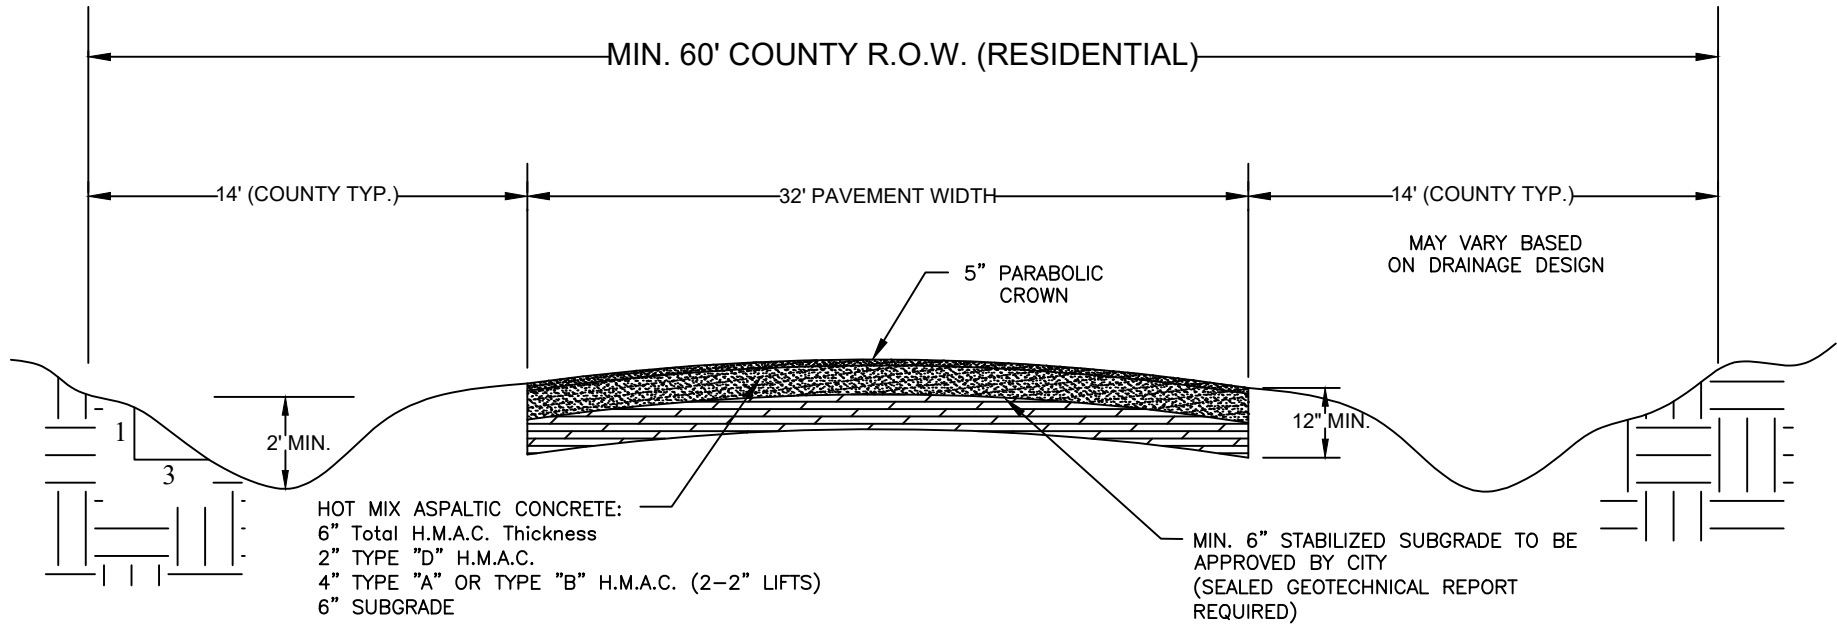


NOTES:

1. BAR DITCH SIDE SLOPE VARIES DEPENDING UPON DESIGN. NO GREATER THAN 3:1 WITHOUT ARMORING.
2. GEOTECHNICAL REPORT PREPARED BY LICENSED ENGINEER IS REQUIRED TO DETERMINE LIME OR CEMENT APPLICATION RATE.
3. SUBGRADE COMPACTION SHALL BE 95% STANDARD PROCTOR DENSITY.



* NOT ALLOWED WITHIN CITY LIMITS WITHOUT PRIOR AUTHORIZATION OF PUBLIC WORKS DIRECTOR

DETAIL NAME / PROJECT NO. NEW RURAL RESIDENTIAL STREET – ASPHALT		SCALE: NOT TO SCALE
ENGINEERING SERVICES DEPARTMENT	FILE:	DATE: 2020 VERSION

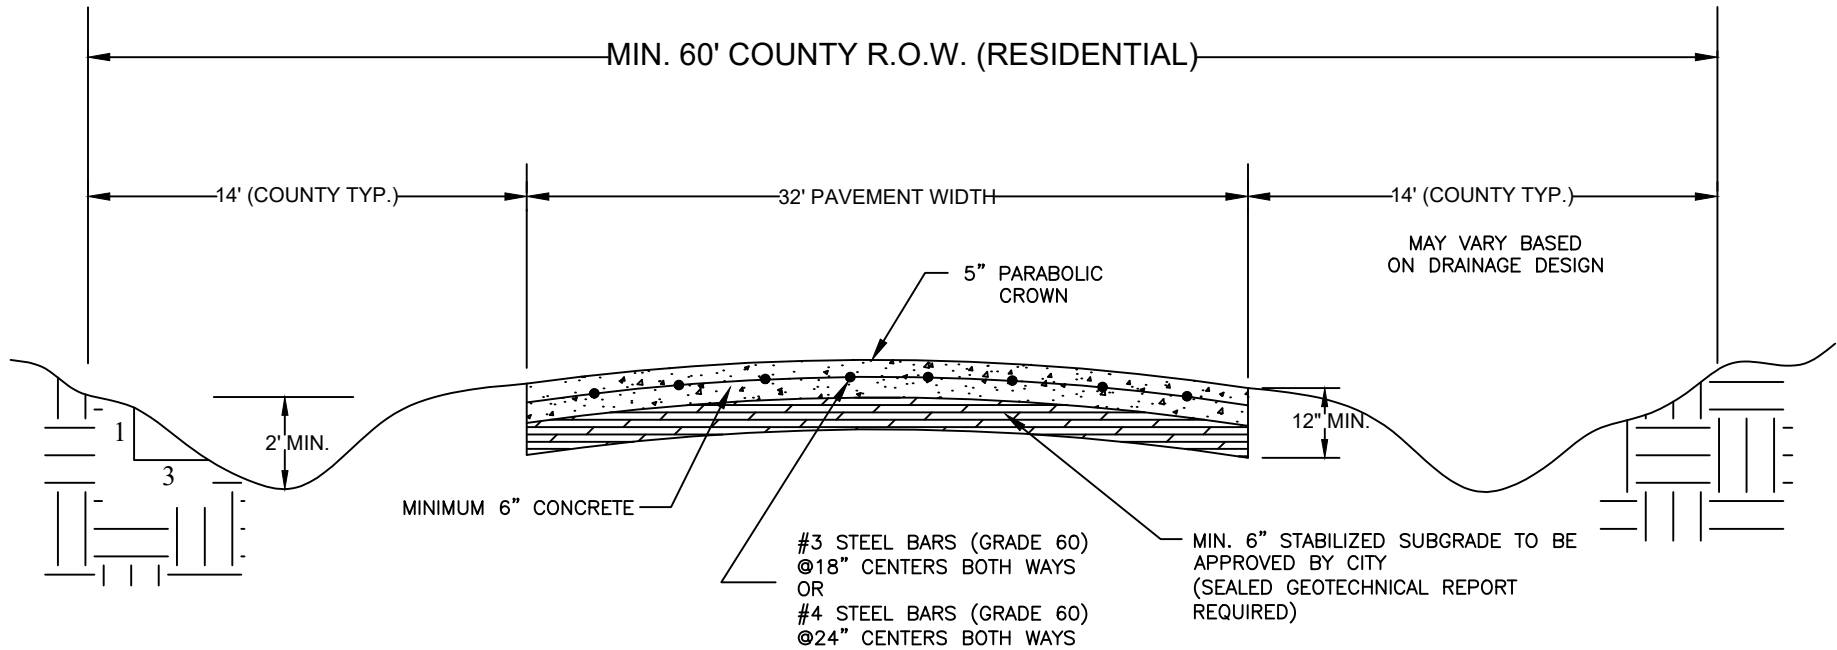

NOTES:

1. BAR DITCH SIDE SLOPE VARIES DEPENDING UPON DESIGN. NO GREATER THAN 3:1 WITHOUT ARMORING.
2. GEOTECHNICAL REPORT PREPARED BY LICENSED ENGINEER IS REQUIRED TO DETERMINE LIME OR CEMENT APPLICATION RATE.
3. SUBGRADE COMPACTION SHALL BE 95% STANDARD PROCTOR DENSITY.



* NOT ALLOWED WITHIN CITY LIMITS WITHOUT PRIOR AUTHORIZATION OF PUBLIC WORKS DIRECTOR

DETAIL NAME / PROJECT NO.		NEW RURAL RESIDENTIAL STREET – CONCRETE	
ENGINEERING SERVICES DEPARTMENT		FILE:	SCALE: NOT TO SCALE
			DATE: 2020 VERSION